

with DWR

DATE 11/11/91

WELL COMPLETION REPORT

Refer to Instruction Pamphlet

STATE WELL NO./STATION NO. _____

LATITUDE _____ LONGITUDE _____

APN/TRS/OTHER _____

Owner's Well No. _____ No. **427993**

Date Work Began **10/13/91** Ended **10/14/91**

Local Permit Agency **SONOMA COUNTY PUBLIC HEALTH**

Permit No. **91-8177 3702** Permit Date **10/14/91**

GEOLOGIC LOG

WELL OWNER

ORIENTATION (∠) VERTICAL _____ HORIZONTAL _____ ANGLE _____ (SPECIFY)

Name **BOB DIXON**

Mailing Address **PO BOX 1672**

SEBASTOPOL CA 95472

CITY STATE ZIP

DEPTH TO FIRST WATER _____ (Ft.) BELOW SURFACE

DEPTH FROM SURFACE

Ft.	to	Ft.	DESCRIPTION
-----	----	-----	-------------

WELL LOCATION

Address **3800 Bay Hill Rd**

City **Rodega Bay**

County **Sonoma**

APN Book **101** Page **03** Parcel **01**

Township _____ Range _____ Section _____

Latitude _____ Longitude _____

Ft.	to	Ft.	DESCRIPTION
0	1		SANDY SOIL
1	12		YELLOW SANDY CLAY
12	22		SOFT YELLOW SANDSTONE
22	48		YELLOW & BLUE MED HARD SANDSTONE
48	85		BLUE HARD GRAYWACKE SANDSTONE
85	130		BLUE OILY SHALE WITH SHORT OCCASSIONAL STREAKS OF BLUE GRAYWACKE SANDSTONE

LOCATION SKETCH

ACTIVITY (∠)

NEW WELL

MODIFICATION/REPAIR

_____ Deepen

_____ Other (Specify): _____

DESTROY (Describe Procedures and Material Under "GEOLOGIC LOG")

PLANNED USE (∠)

_____ MONITORING

WATER SUPPLY

Domestic

_____ Public

_____ Irrigation

_____ Industrial

_____ "TEST WELL"

_____ CATHODIC PROTECTION

_____ OTHER (Specify): _____

Illustrate or Describe Distance of Well from Landmarks such as Roads, Buildings, Fences, Rivers, etc. PLEASE BE ACCURATE & COMPLETE.

TOTAL DEPTH OF BORING _____ (Feet)

TOTAL DEPTH OF COMPLETED WELL _____ (Feet)

DRILLING METHOD **ROTARY AIR** FLUID _____

WATER LEVEL & YIELD OF COMPLETED WELL

DEPTH OF STATIC WATER LEVEL **21** (Ft.) & DATE MEASURED **10/14/91**

ESTIMATED YIELD **1.5** (GPM) & TEST TYPE **AIR LIFT**

TEST LENGTH **1** (Hrs.) TOTAL DRAWDOWN **70** (Ft.)

* May not be representative of a well's long-term yield.

DEPTH FROM SURFACE	BORE-HOLE DIA. (Inches)	CASING(S)						DEPTH FROM SURFACE	ANNULAR MATERIAL			
		TYPE (∠)	MATERIAL/GRADE	INTERNAL DIAMETER (Inches)	GAUGE OR WALL THICKNESS	SLOT SIZE IF ANY (Inches)	CEMENT (∠)		BENTONITE (∠)	FILL (∠)	FILTER PACK (TYPE/SIZE)	
0	25	10"	✓	PVC	5"	C1200	0	21	✓			
25	30	8"	✓	"	"	"	21	90			FINE PER	
30	90	8"	✓	"	"	"	90	130				
90	130	6 1/2"		NONE								

ATTACHMENTS (∠)

- Geologic Log
- Well Construction Diagram
- Geophysical Log(s)
- Soil/Water Chemical Analyses
- Other _____

ATTACH ADDITIONAL INFORMATION, IF IT EXISTS.

CERTIFICATION STATEMENT

I, the undersigned, certify that this report is complete and accurate to the best of my knowledge and belief

NAME **NUTTING & JENSEN DRILLING** DIV. OF E.H.

(PERSON, FIRM, OR CORPORATION) (TYPED OR PRINTED)

ADDRESS **1904 GRAVENSTEIN HWY SO SEBASTOPOL CA 95472**

CITY STATE ZIP

Signed **Larry Jensen** DATE SIGNED **12/1/91** 340854 C57 LICENSE NUMBER

WELL DRILLER/AUTHORIZED REPRESENTATIVE

COUNTY OF SONOMA PUBLIC HEALTH DEPT.

1030 Center Drive, Suite A
Santa Rosa, CA 95403 • Phone: (707) 525-6500

APPLICATION FOR PERMIT

WATER WELL PUBLIC HEALTH DEPARTMENT

OCT 14 1991

DIV. OF E.H.

WELL ADDRESS ~~2620 Bay Hill~~ to supply water for 3000 BAY HILL RD
CITY Bodega Bay ZIP 94923 APPLICATION NO. 91-3702
PROPERTY OWNER Tom Taylor/Bob Dixon A.P. NO. 101-03-01
ADDRESS PO Box 1672 Sebastopol 95473 PHONE NO. _____
DRILLING CONTRACTOR Nutting & Jensen CONTRACTOR LICENSE NO. 340854
ADDRESS 1924 Grawenstem Hwy So Seb PHONE NO. 823-8710

TYPE OF WORK Class I Permit Class II Permit New Well Reconstruct Observation Test well, Test hole Destruct Other: _____

PROPOSED USE Domestic, Single Family Domestic, Public Irrigation Industrial Other: _____

CONSTRUCTION PROPOSED:

Casing: Diameter: 5" Gauge: C1200 Material: PVC Conductor: no yes Single Double Gravel Pack: yes no
Annular Space: Size: 5" Depth of Seal: 20' Concrete: Grout: _____ Neat Cement: _____ Puddled Clay: _____
Method of Disinfection: Chlorine Method of Sealing: Well cap Access Opening: _____ Type of Joint: glue

Receipt Information

Well located within an existing public water system boundary: Yes No Name: _____

I hereby agree to comply with all laws and regulations of the County of Sonoma and State of California pertaining to water well construction. I will telephone (707) 525-6500 to notify the sanitarian when I am commencing this work. I will furnish the Public Health Officer and the owner a legible copy of the State Water Well Driller's Report within 30 days in order to obtain final approval on this well. I acknowledge that the application will become a permit only after site approval and payment of fee. I understand that this permit is not transferable and expires one year from date of issuance.

WORKMEN'S COMPENSATION CERTIFICATE

- A currently effective certificate of Workmen's Comp. Insurance coverage is on file with this office.
- I certify that in the performance of the work for which this permit is issued I shall not employ any person in any manner so as to become subject to the workmen's compensation laws of California.

Insurance Carrier _____ Policy # _____

(SIGNATURE OF WELL DRILLER)

Gary Jensen 10/14/1991

(SIGNATURE OF APPLICANT)

Gary Jensen 10/14/1991

FOR OFFICE USE ONLY - ENVIRONMENTAL HEALTH SERVICE


Site approval by: [Signature] Date: 10/14/1991 Water Scarce Area: yes no
Sealed to depth of _____
Seal Observed: yes no

Indicate below the exact location of well with respect to the following items: property lines, water bodies or water courses, drainage pattern, roads, existing wells, sewer main and laterals and private sewage disposal systems or other sources of contamination or pollution. INCLUDE DIMENSIONS. The validity of this permit depends upon the accuracy of the information provided by the applicant. SONOMA COUNTY CODE, CHAPTER 25B, requires submittal of well log within thirty (30) days of completion of type of work indicated on this permit.

SEE ATTACHED

001343D
WELL PER 233.00
TTLAMT 233.00
CHECKS 233.00
CHANGE 0.00
451B #2 8:03

10/22/91

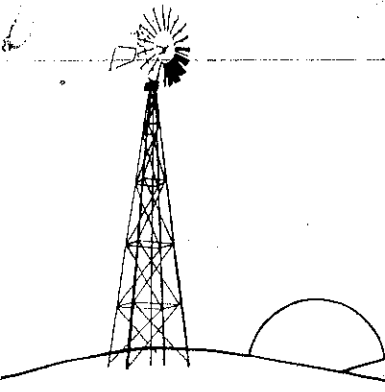

NUTTING & JENSEN DRILLING

1924 GRAVENSTEIN HIGHWAY SOUTH • SEBASTOPOL, CA 95472 • LIC. NO. 340854 • (707) 823-8710


SITE CHANGE
permit #91-3117
Bob Dixon
Po Box 1672 Sebastopol

RADINE

378 ACRE PARCEL

52.38 ACRE PARCEL

RIDGE

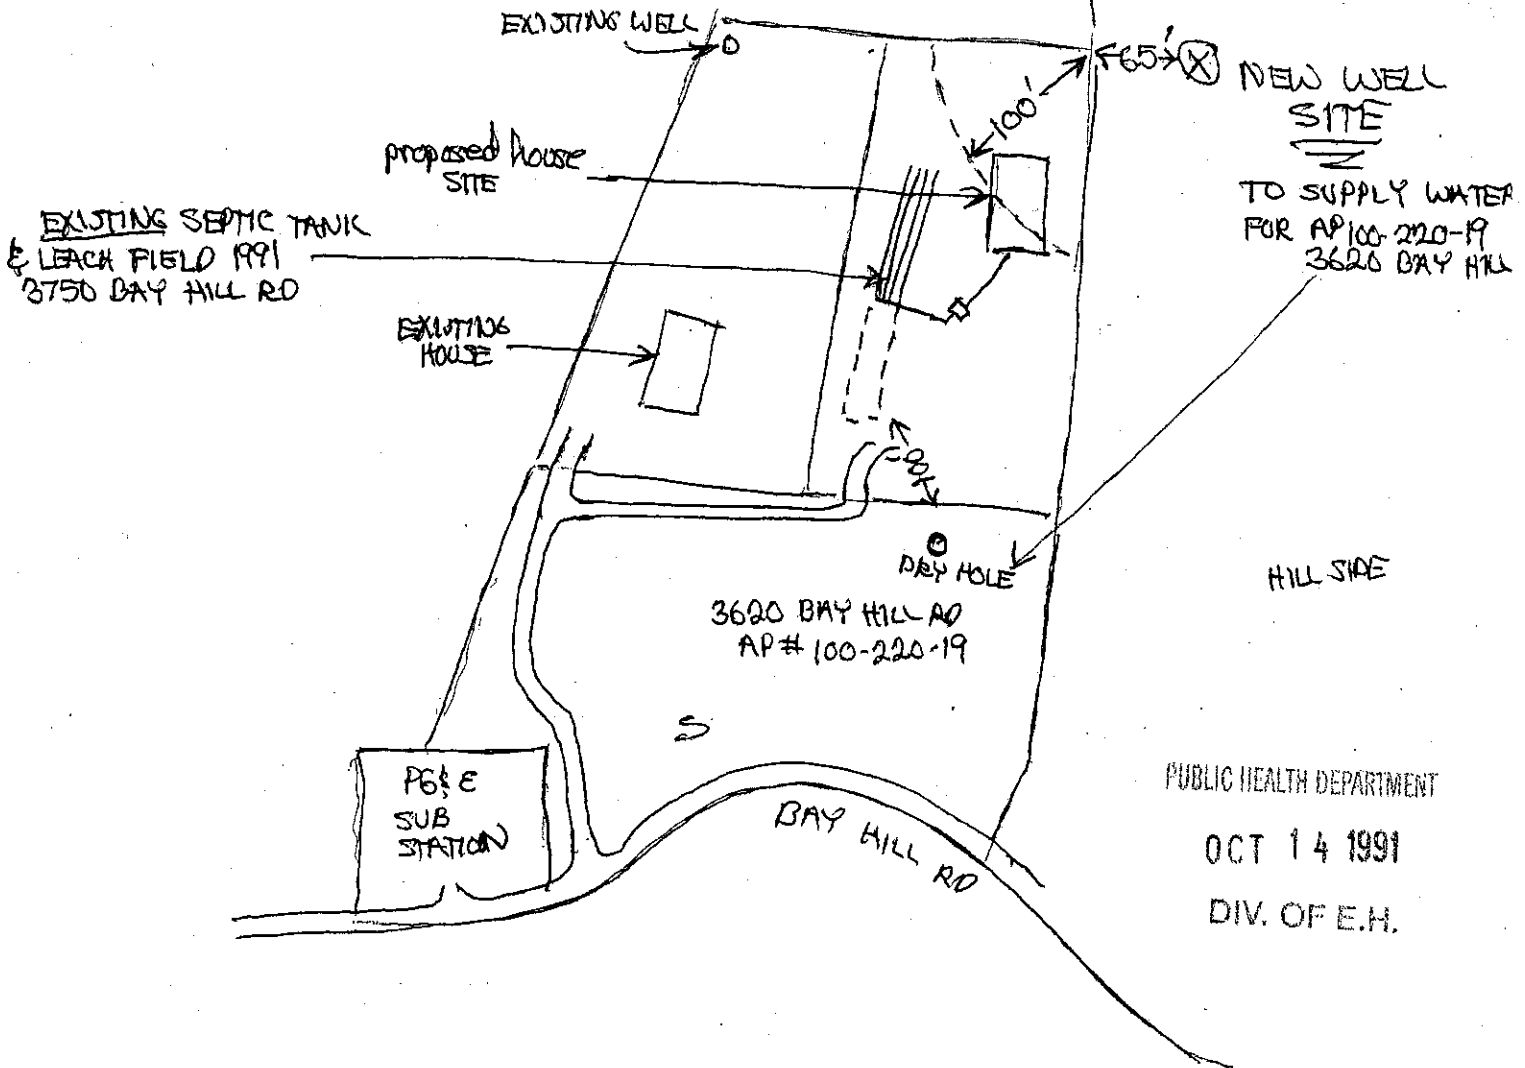

NEW WELL SITE
TO SUPPLY WATER
FOR AP 100-220-19
3620 BAY HILL

PUBLIC HEALTH DEPARTMENT
OCT 14 1991
DIV. OF E.H.

PARCEL MAP


TAX CODE AREA

100-22

57-008
57-009
57-007

Parcel Map No. 6537
Bk. 299 pg 36, Rec. 12-31-79

TOM TAYLOR & ASSOCIATES
3800 BAY HILL RD

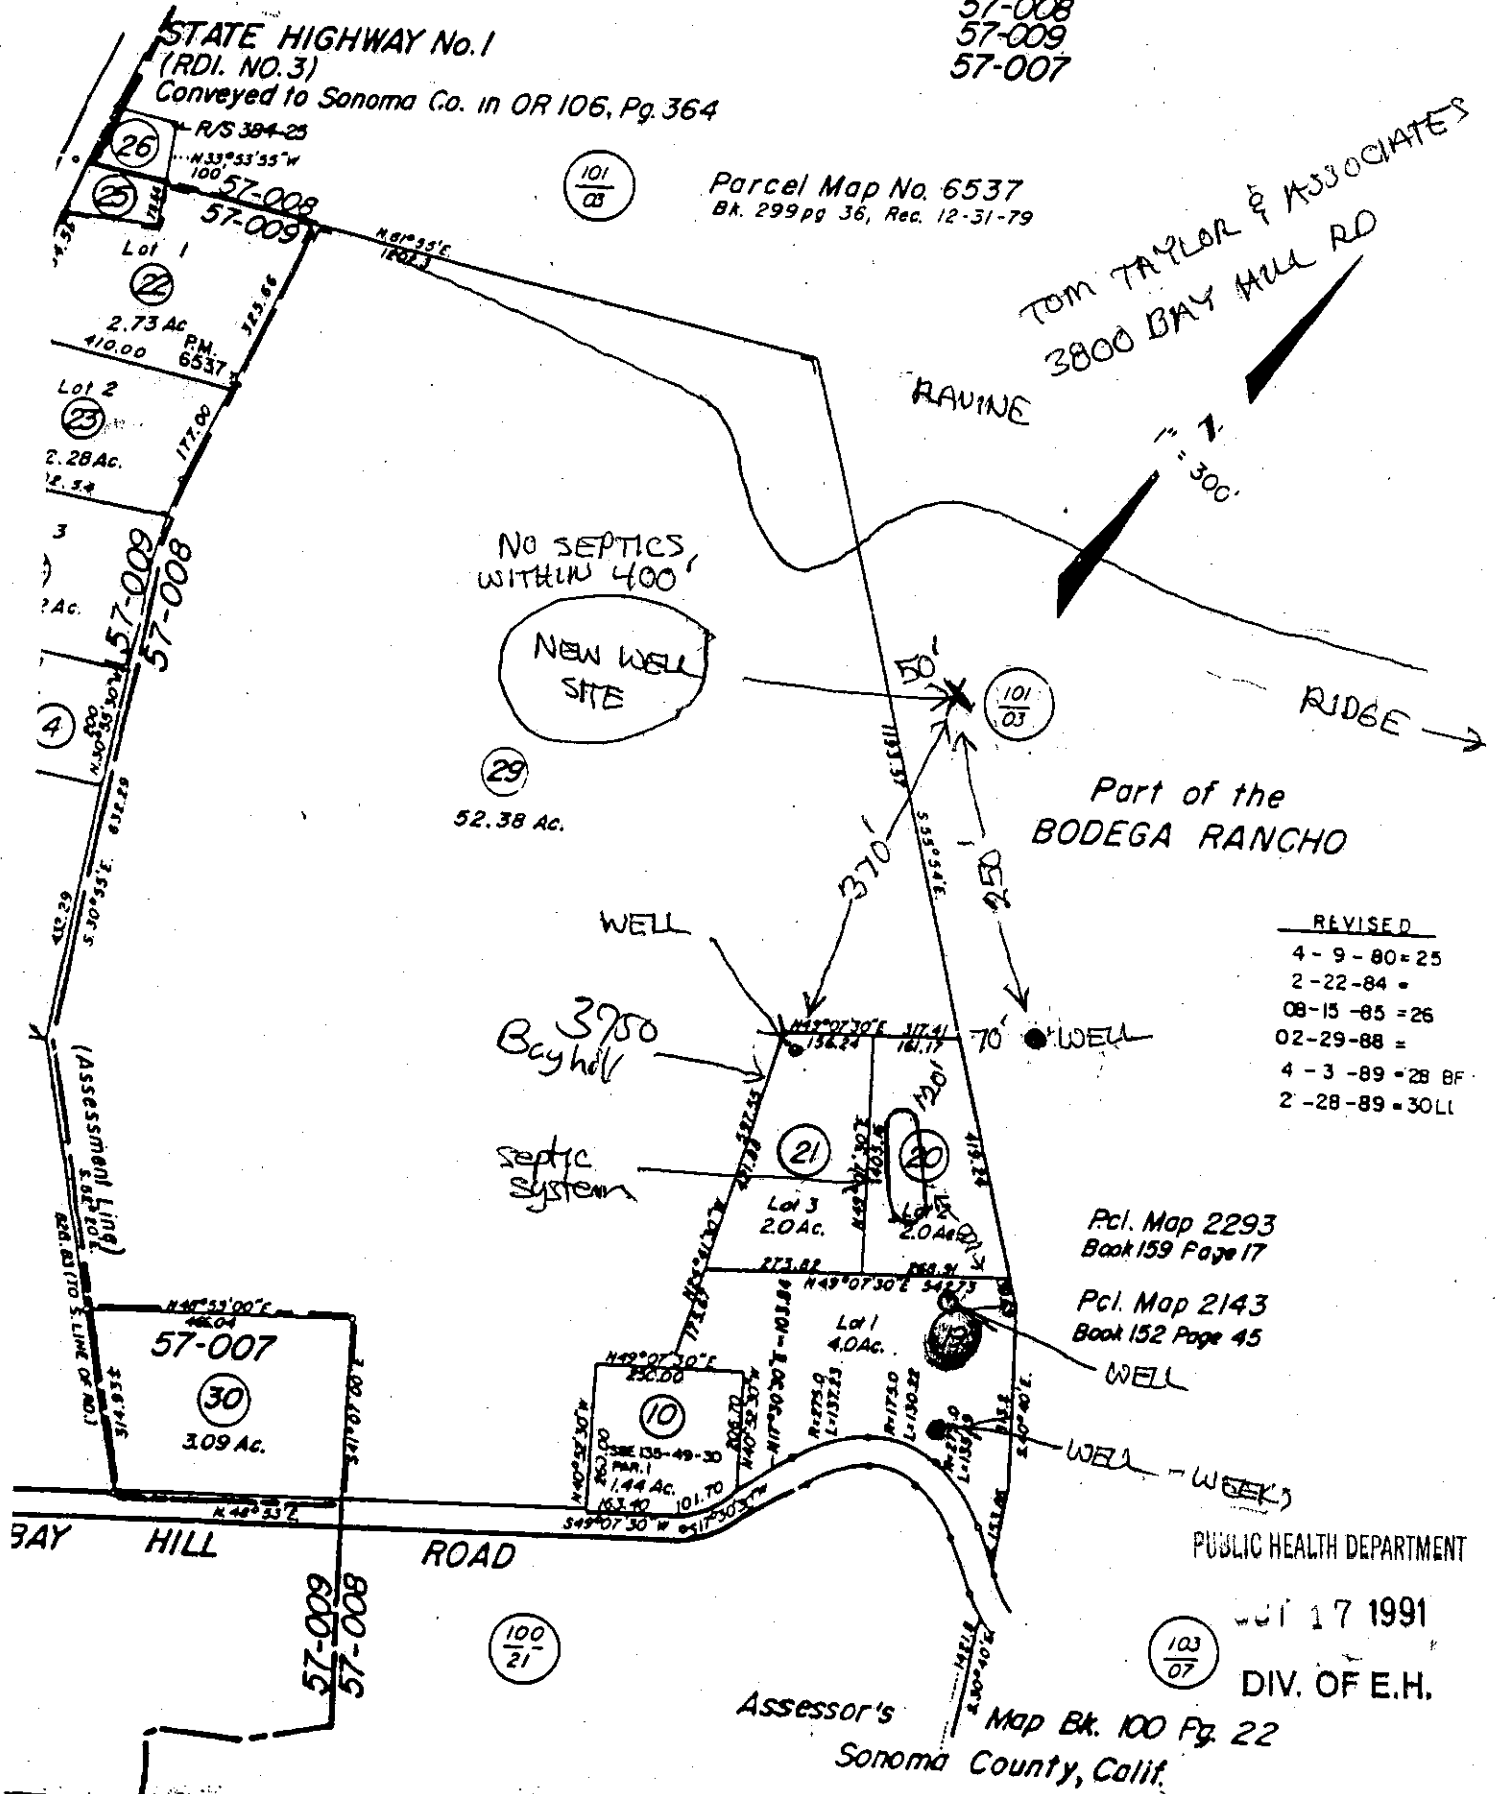

NO SEPTICS WITHIN 400'

NEW WELL SITE

29
52.38 AC.

WELL

3700 Bayhill

septic system

21

20

Lot 3
2.04 AC.

Lot 4
2.04 AC.

Lot 1
4.0 AC.

57-007

30

3.09 AC.

Pcl. Map 2293
Book 159 Page 17

Pcl. Map 2143
Book 152 Page 45

WELL

WELL - WELL

PUBLIC HEALTH DEPARTMENT

Jul 17 1991

DIV. OF E.H.

Assessor's Map Bk. 100 Pg. 22
Sonoma County, Calif.

- REVISED
- 4-9-80=25
 - 2-22-84 =
 - 08-15-85 =26
 - 02-29-88 =
 - 4-3-89 =28 BF
 - 2-28-89 =30LI

101
03

101
03

100
21

103
07

105

DRY HOLE

id# 11672

COUNTY OF SONOMA PUBLIC HEALTH DEPT. APPLICATION FOR PERMIT WATER WELL

1030 Center Drive, Suite A Santa Rosa, CA 95403 • Phone: (707) 525-6500

OCT 17 1991

WELL ADDRESS: 3800 Bay Hill Rd DIV. OF E.H. CITY: Bodega Bay ZIP: APPLICATION NO. 91-3610 PROPERTY OWNER: Tom Taylor & Associates A.P. NO. 101-03-02 ADDRESS: PO Box 1672 Sebastopol PHONE NO. 875-3230 DRILLING CONTRACTOR: Nutting & Jensen CONTRACTOR LICENSE NO. 340854 ADDRESS: 1924 Gravenstein Hwy So Seb PHONE NO. 823-8710

TYPE OF WORK: Class I Permit [X] Class II Permit [] New Well [X] Reconstruct [] Observation [] Test well, Test hole [] Destruct [] Other: [] PROPOSED USE: Domestic Single Family [X] Domestic Public [] Irrigation [] Industrial [] Other: []

Receipt Information table with columns for item and amount. Items include WELL PER (233.00), TITLANT (233.00), CHECKS (233.00), CHANGE (0.00), and 2938 #2 (8:11).

CONSTRUCTION PROPOSED: Casing: Diameter: 5" Gauge: C1200 Material: PVC Conductor: no [X] Single [A] Double [] Gravel Pack: no [] Annular Space: Size: 2" Depth of Seal: 20' Concrete: [X] Grout: [] Neat Cement: [] Puddled Clay: 10/17/91 Method of Disinfection: Chlorine Method of Sealing: Well cap Access Opening: [] Type of Joint: glue

Well located within an existing public water system boundary: [] Yes [X] No Name: []

I hereby agree to comply with all laws and regulations of the County of Sonoma and State of California pertaining to water well construction. I will telephone (707) 525-6500 to notify the sanitarian when I am commencing this work. I will furnish the Public Health Officer and the owner a legible copy of the State Water Well Driller's Report within 30 days in order to obtain final approval on this well. I acknowledge that the application will become a permit only after site approval and payment of fee. I understand that this permit is not transferable and expires one year from date of issuance.

WORKMEN'S COMPENSATION CERTIFICATE

A currently effective certificate of Workmen's Comp. insurance coverage is on file with this office. I certify that in the performance of the work for which this permit is issued I shall not employ any person in any manner so as to become subject to the workmen's compensation laws of California.

Signature of Well Driller: Gary Jensen 10/17/1991


Signature of Applicant: Gary Jensen 10/17/1991

FOR OFFICE USE ONLY - ENVIRONMENTAL HEALTH SERVICE Site approved by: Gwendolyn R Baert Date: 10/17/1991 Water Scarce Area: [] yes [] no Finaled by: DRY HOLE BRB Date: 10/24/91 Sealed to depth of: [] Seal Observed: []

Indicate below the exact location of well with respect to the following items: property lines, water bodies or water courses, drainage pattern, roads, existing wells, sewer main and laterals and private sewage disposal systems or other sources of contamination or pollution. INCLUDE DIMENSIONS. The validity of this permit depends upon the accuracy of the information provided by the applicant. SONOMA COUNTY CODE, CHAPTER 25B, requires submittal of well log within thirty (30) days of completion of type of work indicated on this permit.

see attached



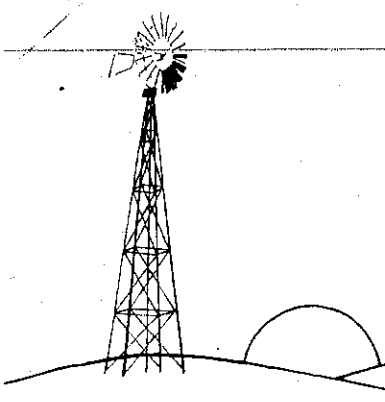

NUTTING & JENSEN ND DRILLING

1924 GRAVENSTEIN HIGHWAY SOUTH • SEBASTOPOL, CA 95472 • LIC. NO. 340854 • (707) 823-8710


SITE CHANGE
permit #91-3117
Bob Dixon
Po Box 1672 Sebastopol

RIDGE

378 ACRE PARCEL

52.38 ACRE PARCEL

RIDGE

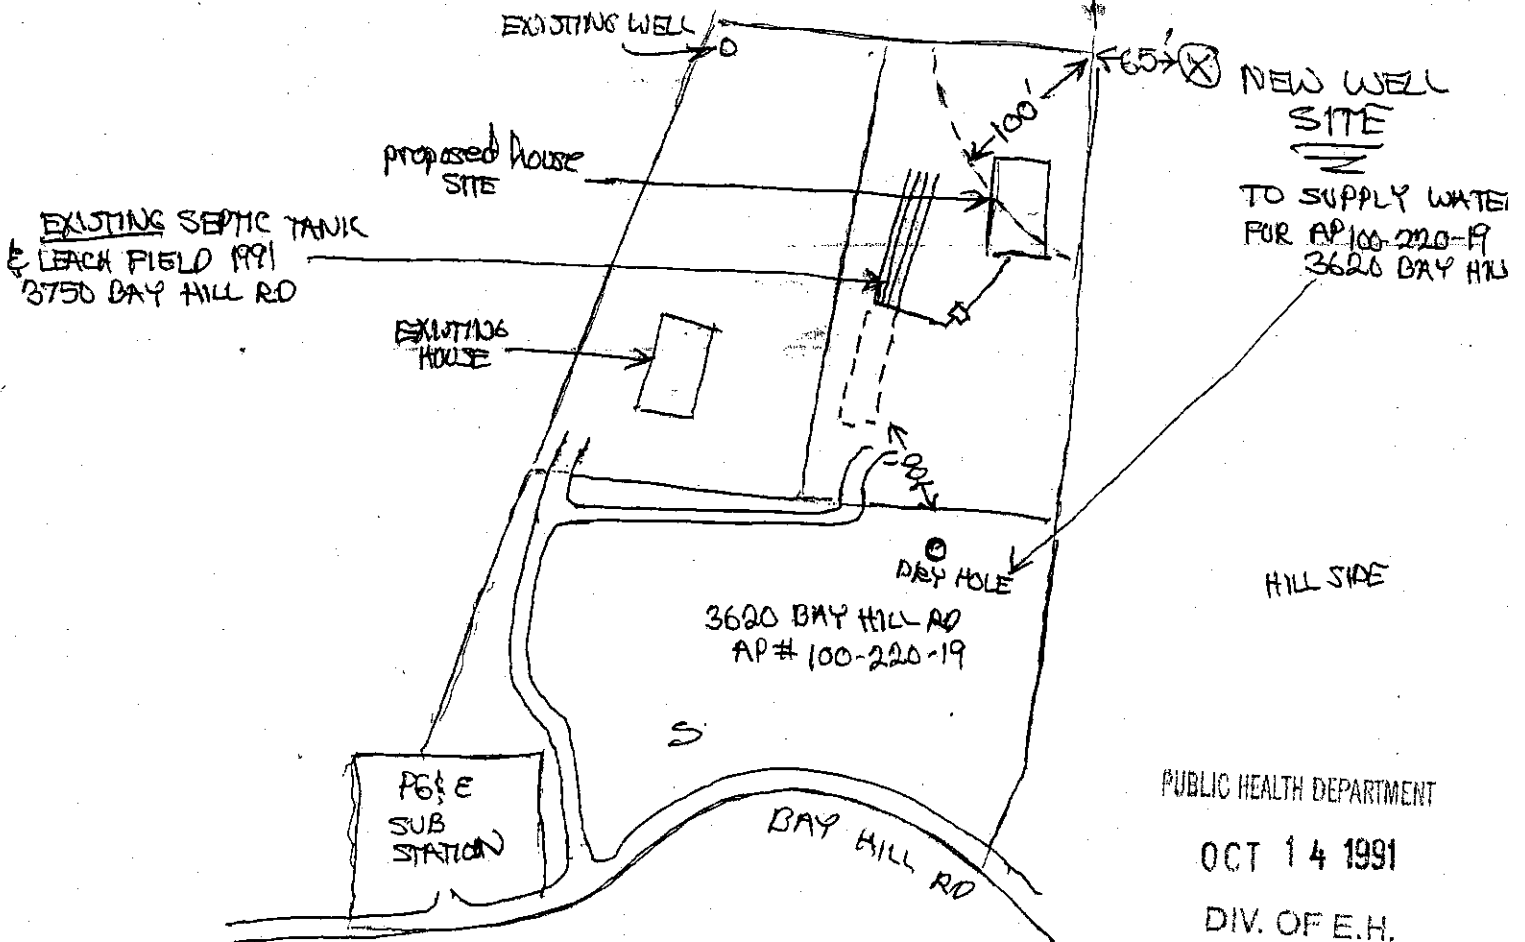

PUBLIC HEALTH DEPARTMENT

OCT 14 1991

DIV. OF E.H.



COUNTY OF SONOMA
PERMIT AND RESOURCE MANAGEMENT DEPARTMENT

2550 Ventura Avenue, Santa Rosa, CA 95403-2829
(707) 565-1900 FAX (707) 565-1103

100

CERTIFICATION OF WATER YIELD IN WATER SCARCE AREAS

The Permit and Resource Management Department shall be notified 24 hours in advance of this test

Pump #: Well 06-0498

Well Permit # 100-220-17
UNKNOWN

- I. Individual performing test: Raymond L. Wilson
- II. Type of license/registration, number and expiration date: C57/C61-Lic#592659-EXP. 01-31-08
- III. Location of well:
Address: 3800 Bay Hill Road, Bodaga Bay A.P. # 100-220-029
- IV. Type and model of test pump: 1 HP Submersible
- V. Test pump setting depth: 28'
- VI. Maximum reported yield for this pump type at this setting: 15 GPM
- VII. Type of discharge measurement method: 5/8" Water meter, Stop Watch & 5 Gal Bucket
- VIII. Type and model of flow meter (or provide an accurate description of well or orifice plate):
5/8" Sensus Water Meter

Geographic coordinates (Plane Coordinate Method or distance from fixed landmarks): 38°-20'-41N
123°-02'-41W

- IX. Estimated elevation of well head: 186' - Casing is 13" above ground level
- X. Initial static water level (include measuring points such as top of casing, surface seal, access port): zero - measured from top of the well casing.

XI. Date & time of initial static water level measurement: 9/14/06 7:22 a.m.

- A. Discharge Rate: 1.86
- B. Dynamic Water Level: 28'
- C. Specific Capacity: 0.07
- D. Pump Test duration: 9 Hrs. 8 Mins.

This Well is not in service at this time.

XII. Immediately after the test take the following measurements:

- A. Dynamic water level: 28'
- B. Final discharge rate: 1.86

XIII. Post - Test Measurement:

- A. Dynamic water level: zero
- B. Static water level: zero
- C. Percentage of recovery of final static level: 100%

Testing performed by (signature): Raymond L. Wilson

Date: 9-14-06 Company: Ray's Well Testing Service Phone Number: 707-823-3191

Approved Denied

Specialist: Christina Stevens

Date: 10-12-06

Well Pump Test Data Recordation

Address: 3800 Bay Hill Road, Bodega Bay, CA

Date	Time	Interval	SWL	GPM	Comments
9-14-06	7:22 AM	1 Min	Zero	15	
9-14-06	7:23 AM	1 Min	4'	15	
9-14-06	7:24 AM	1 Min	10'	15	
9-14-06	7:25 AM	1 Min	15'	15	
9-14-06	7:26 AM	1 Min	16'	15	
9-14-06	7:31 AM	5 Mins	18'	15	
9-14-06	7:36 AM	5 Mins	22'	15	
9-14-06	7:41 AM	5 Mins	24' 6"	9	
9-14-06	7:46 AM	5 Mins	26' 6"	3	
9-14-06	7:51 AM	5 Mins	28'	2	
9-14-06	7:56 AM	5 Mins	28'	2	
9-14-06	8:01 AM	5 Mins	28'	2	
9-14-06	8:06 AM	5 Mins	28'	2	
9-14-06	8:11 AM	5 Mins	28'	2	
9-14-06	8:16 AM	5 Mins	28'	2	
9-14-06	8:21 AM	5 Mins	28'	2	
9-14-06	8:26 AM	5 Mins	28'	2	
9-14-06	8:46 AM	20 Mins	28'	2	
9-14-06	9:06 AM	20 Mins	28'	2	
9-14-06	9:26 AM	20 Mins	28'	2	
9-14-06	9:56 AM	30 Mins	28'	2	
9-14-06	10:26 AM	30 Mins	28'	2	
9-14-06	10:56 AM	30 Mins	28'	2	
9-14-06	11:26 AM	30 Mins	28'	2	
9-14-06	11:56 AM	30 Mins	28'	2	
9-14-06	12:26 AM	30 Mins	28'	1.86	
9-14-06	12:56 AM	30 Mins	28'	1.86	
9-14-06	1:26 PM	30 Mins	28'	1.86	
9-14-06	1:56 PM	30 Mins	28'	1.86	
9-14-06	2:26 PM	30 Mins	28'	1.86	
9-14-06	2:56 PM	30 Mins	28'	1.86	
9-14-06	3:26 PM	30 Mins	28'	1.86	
9-14-06	3:56 PM	30 Mins	28'	1.86	
9-14-06	4:26 PM	30 Mins	28'	1.86	
9-14-06	4:56 PM	30 Mins	28'	1.86	
9-14-06	5:30 PM	30 Mins	28'	1.86	
		30 Mins	8 Hours 30 Minutes		
		30 Mins			
		30 Mins			
		30 Mins			
Water level recovered 100% in 22 Hours & 50 Minutes-Measured 9-15-06					
		72 Hrs			

California Home

Wednesday, September 27, 2006

Welcome to

California

License Detail

CALIFORNIA CONTRACTORS STATE LICEN

Contractor License # 592659

DISCLAIMER

A license status check provides information taken from the CSLB license data base. Before on this information, you should be aware of the following limitations:

- CSLB complaint disclosure is restricted by law (B&P 7124.6). If this entity is subject to complaint disclosure, a link for complaint disclosure will appear below. Click on the link button to obtain complaint and/or legal action information.
- Per B&P 7071.17, only construction related civil judgments reported to the CSLB are disclosed.
- Arbitrations are not listed unless the contractor fails to comply with the terms of the arbitration.
- Due to workload, there may be relevant information that has not yet been entered on Board's license data base.

Extract Date: 09/27/2006

RETAIN
needs-0495

***** Business Information *****

RAY'S WELL TESTING SERVICE
885 WEST SEXTON RD
SEBASTOPOL, CA 95472
Business Phone Number: (707) 823-3191

Entity: Sole Ownership
Issue Date: 04/25/1991 Expire Date: 01/31/2009

***** License Status *****

This license is current and active. All information below should be reviewed.

***** Classifications *****

Class	Description
C57	WELL DRILLING (WATER)
D21	MACHINERY AND PUMPS

***** Bonding Information *****

CONTRACTOR'S BOND: This license filed Contractor's Bond number CLB2708294 in the

of \$10,000 with the bonding company
PLATTE RIVER INSURANCE COMPANY.
Effective Date: 11/27/2005

Contractor's Bonding History

***** Workers Compensation Information *****

This license is exempt from having workers compensation insurance; they certified that they
employees at this time.

Effective Date: 08/22/1991 Expire Date: None

Personnel List

<u>License Number Request</u>	<u>Contractor Name Request</u>	<u>Personnel Name Request</u>
<u>Salesperson Request</u>	<u>Salesperson Name Request</u>	

© 2006 State of California. Conditions of Use Privacy Policy

Well Pump Test Data Recordation

Address: 3800 Bay Hill Road, Bodega Bay, CA

Date	Time	Interval	SWL	GPM	Comments
9-14-06	7:22 AM	1 Min	Zero	15	
9-14-06	7:23 AM	1 Min	4'	15	
9-14-06	7:24 AM	1 Min	10'	15	
9-14-06	7:25 AM	1 Min	15'	15	
9-14-06	7:26 AM	1 Min	16'	15	
9-14-06	7:31 AM	5 Mins	18'	15	
9-14-06	7:36 AM	5 Mins	22'	15	
9-14-06	7:41 AM	5 Mins	24' 6"	9	
9-14-06	7:46 AM	5 Mins	26' 6"	3	
9-14-06	7:51 AM	5 Mins	28'	2	
9-14-06	7:56 AM	5 Mins	28'	2	
9-14-06	8:01 AM	5 Mins	28'	2	
9-14-06	8:06 AM	5 Mins	28'	2	
9-14-06	8:11 AM	5 Mins	28'	2	
9-14-06	8:16 AM	5 Mins	28'	2	
9-14-06	8:21 AM	5 Mins	28'	2	
9-14-06	8:26 AM	5 Mins	28'	2	
9-14-06	8:46 AM	20 Mins	28'	2	
9-14-06	9:06 AM	20 Mins	28'	2	
9-14-06	9:26 AM	20 Mins	28'	2	
9-14-06	9:56 AM	30 Mins	28'	2	
9-14-06	10:26 AM	30 Mins	28'	2	
9-14-06	10:56 AM	30 Mins	28'	2	
9-14-06	11:26 AM	30 Mins	28'	2	
9-14-06	11:56 AM	30 Mins	28'	2	
9-14-06	12:26 AM	30 Mins	28'	1.86	
9-14-06	12:56 AM	30 Mins	28'	1.86	
9-14-06	1:26 PM	30 Mins	28'	1.86	
9-14-06	1:56 PM	30 Mins	28'	1.86	
9-14-06	2:26 PM	30 Mins	28'	1.86	
9-14-06	2:56 PM	30 Mins	28'	1.86	
9-14-06	3:26 PM	30 Mins	28'	1.86	
9-14-06	3:56 PM	30 Mins	28'	1.86	
9-14-06	4:26 PM	30 Mins	28'	1.86	
9-14-06	4:56 PM	30 Mins	28'	1.86	
9-14-06	5:30 PM	30 Mins	28'	1.86	
		30 Mins	8 Hours 30 Minutes		
		30 Mins			
		30 Mins			
		30 Mins			
Water level recovered 100% in 22 Hours & 50 Minutes-Measured 9-15-06					
		72 Hrs			



COUNTY OF SONOMA
PERMIT AND RESOURCE MANAGEMENT DEPARTMENT

2550 Ventura Avenue, Santa Rosa, CA 95403-2829
 (707) 565-1900 FAX (707) 565-1193

1:00

CERTIFICATION OF WATER YIELD IN WATER SCARCE AREAS
The Permit and Resource Management Department shall be notified 24 hours in advance of this test

Pump#: Well 06-0498

Well Permit # 100-220-17
unknown

- I. Individual performing test: Raymond L. Wilson
- II. Type of license/registration, number and expiration date: C57/C61-Lic#592659-EXP. 01-31-08
- III. Location of well:
 Address: 3800 Bay Hill Road, Bodega Bay AP.# 100-220-029
- IV. Type and model of test pump: 1 HP Submersible
- V. Test pump setting depth: 28'
- VI. Maximum reported yield for this pump type at this setting: 15 GPM
- VII. Type of discharge measurement method: 5/8" Water meter, Stop Watch & 5 Gal Bucket
- VIII. Type and model of flow meter (or provide an accurate description of weir or orifice plate):
5/8" Sensus Water Metet

Geographic coordinates (Plane Coordinate Method or distance from fixed landmarks): 38°-20'-41N
123°-02'-41W

IX. Estimated elevation of well head: 186' - Casing is 13" above ground level

X. Initial static water level (include measuring points such as top of casing, surface seal, access port): zero - measured from top of the well casing.

XI. Date & time of initial static water level measurement: 9/14/06 7:22 a.m.

- A. Discharge Rate: 1.86
- B. Dynamic Water Level: 28'
- C. Specific Capacity: 0.07
- D. Pump Test duration: 9 Hrs. 8 Mins.

This Well is not in service at this time.

XII. Immediately after the test take the following measurements:

- A. Dynamic water level: 28'
- B. Final discharge rate: 1.86

XIII. Post - Test Measurement:

- A. Dynamic water level: zero
- B. Static water level: zero
- C. Percentage of recovery of final static level: 100%


Testing performed by (signature): Raymond L. Wilson

Date: 9-14-06 Company: Ray's Well Testing Service Phone Number: 707-823-3191

Approved Denied

Specialist: Cristina Stokes

Date: 10-12-06



LICENSE NO. C57-177681

"WHEN YOU THINK OF WATER THINK OF WEEKS"

WEEKS DRILLING & PUMP CO., INC.


Phones: (707) 823-3184 or (707) 542-3272

P. O. Box 176

6100 SEBASTOPOL ROAD

SEBASTOPOL, CALIFORNIA 95472

UKIAH OFFICE: Phone (707) 462-9080



August 1, 1986

Bodega Reyn
P. O. Box 221
Bodega Bay, CA 94923

Job Location: 2380 Hwy. One
Bodega Bay, CA

132'	Non-rock drilling @ 24.50/ft.	3,234.00
31'	8" PVC casing installed at 9.00/ft.	279.00
4½ yds	Gravel	85.86
2 yds	Ready-mix	148.40
	Well permit	147.00
20'	Perforations @1.00/ft.	20.00
	Move-in, move-out	150.00
		<u>\$4,064.26</u>
6%	State sales tax on materials (409.26)	24.56
		<u>\$4,088.82</u>

Invoice # 60747

A DISCOUNT OF 528⁰⁰ WILL BE
ALLOWED IF THIS BILL IS PAID ON
OR BEFORE September 1st 1986

THANK YOU!

Thank-you for your patronage!

Sincerely,
Dave Anderson



COUNTY OF SONOMA
PERMIT AND RESOURCE MANAGEMENT DEPARTMENT

2550 Ventura Avenue, Santa Rosa, CA 95403-2829
(707) 565-1900 FAX (707) 565-1993

1:00

CERTIFICATION OF WATER YIELD IN WATER SCARCE AREAS

The Permit and Resource Management Department shall be notified 24 hours in advance of this test

Pump #: Well 06-0498

Well Permit # 100-220-17
unknown

- I. Individual performing test: Raymond L. Wilson
- II. Type of license/registration, number and expiration date: C57/C61-Lic#592659-EXP.01-31-08
- III. Location of well:
Address: 3800 Bay Hill Road, Bodega Bay AP.#: 100-220-029
- IV. Type and model of test pump: 1 HP Submersible
- V. Test pump setting depth: 28'
- VI. Maximum reported yield for this pump type at this setting: 15 GPM
- VII. Type of discharge measurement method: 5/8" Water meter, Stop Watch & 5 Gal Bucket
- VIII. Type and model of flow meter (or provide an accurate description of weir or orifice plate):
5/8" Sensus Water Metet
- IX. Geographic coordinates (Plane Coordinate Method or distance from fixed landmarks): 38°-20'-41N
123°-02'-41W
- X. Estimated elevation of well head: 186' - Casing is 13" above ground level
- XI. Initial static water level (include measuring points such as top of casing, surface seal, access port): zero - measured
from top of the well casing.
- XI. Date & time of initial static water level measurement: 9/14/06 7:22 p.m.

- A. Discharge Rate: 1.86
- B. Dynamic Water Level: 28'
- C. Specific Capacity: 0.07
- D. Pump Test duration: 9 Hrs. 8 Mins.

This Well is not in service at this time.

XII. Immediately after the test take the following measurements:

- A. Dynamic water level: 28'
- B. Final discharge rate: 1.86

XIII. Post - Test Measurement:

- A. Dynamic water level: zero
- B. Static water level: zero
- C. Percentage of recovery of final static level: 100%

Testing performed by (signature): Raymond L. Wilson

Date: 9-14-06

Company: Ray's Well Testing Service

Phone Number: 707-823-3191

Approved Denied

Specialist Caroline Stokes

Date 10-12-06